



The Royal Society is the world's leading
 independent scientific academy, promoting
 excellence in research and scholarship, and
 working for the benefit of humanity.



AirCoV2

Risk calculator for aerosol tra



*shared first author

AirCoV2 - 24082020



AirCoV2 Risk calculator for aerosol transmission of SARS-CoV2

- Uitbreiding blootstellingsscenario's met
 - Besmettelijke persoon en blootgestelde personen tegelijkertijd in de binnenruimte
 - Afmetingen ruimte
 - Aantallen blootgestelde personen
 - Verblijfsduur
 - Ventilatie
 - Fractie intacte virusdeeltjes
 - Fractie infectieuze virusdeeltjes
- Interactieve rekentool
- Output
 - Concentratie virusdeeltjes in de binnenruimte als functie van de tijd
 - Cumulatieve dosis
 - Kans op blootstelling/infectie van tenminste één persoon




AirCoV2 model

- Constante toename aantal virusdeeltjes door besmet personen ten gevolge van uitademen/spreken (lineaire toename)
- Door één keer hoesten of nieseen een bepaalde beginconcentratie van virusdeeltjes in de lucht
- Virusdeeltjes verdwijnen met een bepaalde snelheid (exponentiële afname)
 - Inactivatie van het virus
 - Ventilatie
 - Inademing door blootgestelde personen
- Dosis
 - Cumulatieve dosis over de verblijfsduur
 - Exponentiële dosisresponsrelatie
- Aanname
 - Gelijkmatige verdeling van de virusdeeltjes in de binnenruimte



AirCoV2 data

- Verdelingen van gemeten aerosolen met initiële diameter $\leq 60\mu\text{m}$; totale volume; literatuurgegevens

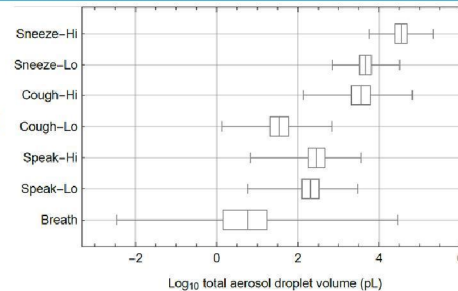

- Concentraties SARS-CoV2 in mucus (RIVM PCR metingen)
50% $\geq 10^5/\text{ml}$; 20% $\geq 10^7/\text{ml}$; 5% $\geq 10^8/\text{ml}$
- Fractie intacte virusdeeltjes 0.6, Lednickey et al. (2020),
Viable SARS-CoV-2 in the air of a hospital room 1 with COVID-19 patients
2-5m away from patients
See also Santarpia et al. (2020)

Table 3. Estimate of viable virus counts based on TCID₅₀ tests.

Sample ID	Virus genome equivalents/L of air ^a	TCID ₅₀ /100 μL	Viable virus count/L air
1-1 BioSpot	94	2.68E+04	74
1-2 BioSpot + HEPA	-	0	0
1-3 BioSpot	30	6.31E+03	18
2-1 VIVAS	44	1.00E+04	27
2-2 VIVA S+ HEPA	-	0	0
2-3 VIVAS	16	2.15E+03	6

^aFrom Table 2.



AirCoV2 aannames

- Virusconcentratie in aerosol druppels = virusconcentratie in mucus
- Gelijkmatige verdeling van de virusdeeltjes in de binnenruimte
- Hoog infectieus virus, exponentiele dosisrespons, $r=0,1$ (onbekend)



AirCoV2

- Scenario
 - Ruimte: l x b x h
 - Ventilatie
 - Eén besmettelijke persoon met bepaalde virusconcentratie (10^2 - 10^{11} per ml)
 - Aantal blootgestelde personen en verblijfsduur
 - Virus infectiviteit

AirCoV2

SCENARIO

Meeting room

Length, m: 15

Width, m: 15

Height, m: 3

Volume, m³: 680.

Ventilation

☒ liter/sec/person: 0

☐ m³/h: 0.

One infected person

Virus/ml in mucus 10⁻⁸: 8

P[10⁻⁸ virus/ml]: 8.5%

Exposed person(s)

Number: 10

Exposure time, min.: 60

Virus infectivity

Intact fraction: 0.6

Infectious fraction: 0.1

Virus concentration in the air

☒ Virus/room ☐ Virus/L

National Institute for Public Health and the Environment
Ministry of Health, Welfare and Sport

Risk calculator for aerosol transmission of SARS-CoV2

Results | Model | Data | References | About | History

Breathe-Lo	Tidal breathing, pL/20min.	Fabian et al. (2011)
Breathe-Hi	10x Tidal breathing, pL/20min.	-
Speak-Lo	pL/20min.	Asadi et al. (2019)
Speak-Hi	pL/20min.	Duguid (1946)
Cough-Lo	one cough, pL	Lindsley et al. (2012)
Cough-Hi	one cough, pL	Duguid (1946)
Sneeze-Lo	one sneeze, pL	Gerone et al. (1966)
Sneeze-Hi	one sneeze, pL	Duguid (1946)


Figure from Schijven et al. (2020)

Log₁₀ total aerosol droplet volume (pL)



AirCoV2

- Vergadering
- Geen ventilatie
- Tien+één personen
- Duurt één uur

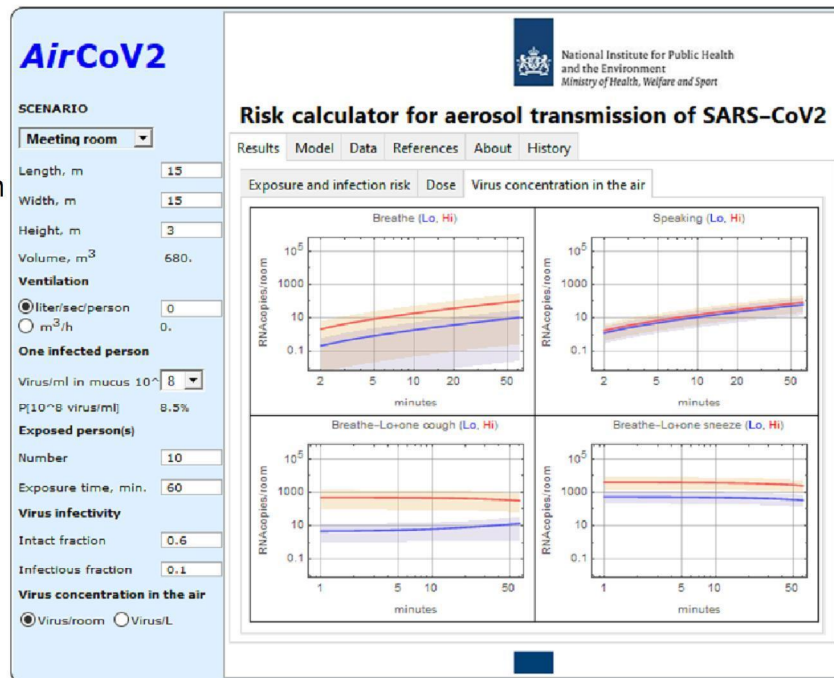



AirCoV2

- Vergadering
- Geen ventilatie
- Tien+één personen
- Duurt één uur

AirCoV2

SCENARIO

Meeting room

Length, m: 15

Width, m: 15

Height, m: 3

Volume, m³: 680.

Ventilation

☒ liter/sec/person: 0

☐ m³/h: 0.

One infected person

Virus/ml in mucus 10⁴: 8

P[10⁴ virus/ml]: 8.5%

Exposed person(s)

Number: 10

Exposure time, min.: 60

Virus infectivity

Intact fraction: 0.6

Infectious fraction: 0.1

Virus concentration in the air

☒ Virus/room ☐ Virus/L

National Institute for Public Health and the Environment
Ministry of Health, Welfare and Sport

Risk calculator for aerosol transmission of SARS-CoV2

Results | Model | Data | References | About | History

Exposure and infection risk | Dose | Virus concentration in the air

	Cumulative dose of exposure time								
	All MC samples				% pos	Positive MC samples			
	Mean	5%	50%	95%		Mean	5%	50%	95%
Breathe-Lo	0.037	0	0	0	2.5%	1.5	1	1	4
Breathe-Hi	0.34	0	0	1	12%	2.7	1	1	8
Speak-Lo	0.21	0	0	1	18%	1.2	1	1	2
Speak-Hi	0.28	0	0	1	22%	1.2	1	1	2
Cough-Lo	0.055	0	0	0	4.4%	1.3	1	1	2
Cough-Hi	2.4	0	2	8	77%	3.1	1	2	8
Sneeze-Lo	2.6	0	2	6	87%	3.	1	3	7
Sneeze-Hi	19.	6	17	40	100%	19.	6	17	40



AirCoV2

- Vergadering
- Geen ventilatie
- Tien+één personen
- Duurt één uur

AirCoV2

SCENARIO

Meeting room

Length, m: 15

Width, m: 15

Height, m: 3

Volume, m³: 680.

Ventilation

☒ liter/sec/person: 0

☐ m³/h: 0.

One infected person

Virus/ml in mucus 10⁸: 8

P[10⁸ virus/ml]: 0.5%

Exposed person(s)

Number: 10

Exposure time, min.: 60

Virus infectivity

Intact fraction: 0.6

Infectious fraction: 0.1

Virus concentration in the air

☒ Virus/room ☐ Virus/L

National Institute for Public Health and the Environment
Ministry of Health, Welfare and Sport

Risk calculator for aerosol transmission of SARS-CoV2

Results | Model | Data | References | About | History

Exposure and infection risk | Dose | Virus concentration in the air

	Exposure probability				Infection risk			
	Mean	5%	50%	95%	Mean	5%	50%	95%
Breathe-Lo	1.3%	0%	0%	0%	0.2%	0%	0%	0%
Breathe-Hi	7.2%	0%	0%	45%	1.5%	0%	0%	5.8%
Speak-Lo	8.6%	0%	0%	45%	1.2%	0%	0%	5.8%
Speak-Hi	11%	0%	0%	45%	1.6%	0%	0%	5.8%
Cough-Lo	2.2%	0%	0%	0%	0.31%	0%	0%	0%
Cough-Hi	55%	0%	70%	99%	12%	0%	11%	38%
Sneeze-Lo	64%	0%	70%	97%	14%	0%	11%	30%
Sneeze-Hi	99%	97%	100%	100%	62%	30%	64%	91%

Probability of exposing and infecting at least one person via aerosol transmission of virus from one infected person.

Exposure probability and infecting risk are equal if the fractions of intact virus particles and of virus particles giving infection are both equal to one.


The probability of this scenario occurring depends on the prevalence of the virus infection and the frequency of persons meeting in this kind of room for this period of time.




Concentratie virusdeeltjes in de lucht

- Vergadering
- Tien+één personen
- Duurt één uur
- 1: geen ventilatie
- 2: 12 L/s/p=432m³/uur=0,1xruimte/10min.
- 3: 120 L/s/p=432m³/uur=1xruimte/10min.


2

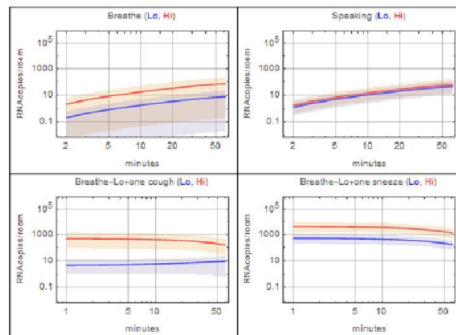

1

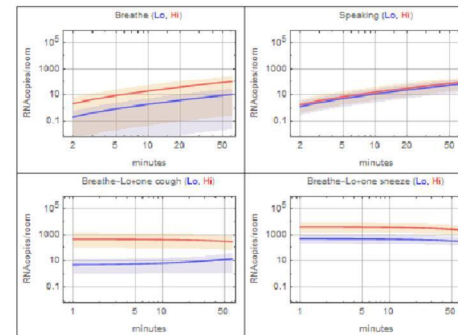

3

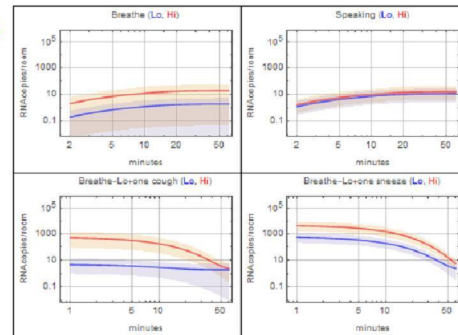



Cumulatieve dosis

- Vergadering
- Tien+één personen
- Duurt één uur
- 1: geen ventilatie
- 2: 12 L/s/p=432m3/uur=0,1xruimte/10min.
- 3: 120 L/s/p=432m3/uur=1xruimte/10min.

1	Cumulative dose of exposure time									
	All MC samples					Positive MC samples				
	Mean	5%	50%	95%	% pos	Mean	5%	50%	95%	
Breathe-Lo	0.037	0	0	0	2.5%	1.5	1	1	4	
Breathe-Hi	0.34	0	0	1	12%	2.7	1	1	8	
Speak-Lo	0.21	0	0	1	18%	1.2	1	1	2	
Speak-Hi	0.28	0	0	1	22%	1.2	1	1	2	
Cough-Lo	0.055	0	0	0	4.4%	1.3	1	1	2	
Cough-Hi	2.4	0	2	8	77%	3.1	1	2	8	
Sneeze-Lo	2.6	0	2	6	87%	3.	1	3	7	
Sneeze-Hi	19.	6	17	40	100%	19.	6	17	40	

2	Cumulative dose of exposure time									
	All MC samples					Positive MC samples				
	Mean	5%	50%	95%	% pos	Mean	5%	50%	95%	
Breathe-Lo	0.028	0	0	0	1.9%	1.5	1	1	3	
Breathe-Hi	0.28	0	0	1	11%	2.7	1	1	8	
Speak-Lo	0.17	0	0	1	15%	1.1	1	1	2	
Speak-Hi	0.23	0	0	1	20%	1.2	1	1	2	
Cough-Lo	0.044	0	0	0	3.5%	1.3	1	1	3	
Cough-Hi	1.8	0	1	6	70%	2.6	1	2	7	
Sneeze-Lo	1.9	0	2	5	79%	2.4	1	2	6	
Sneeze-Hi	15.	4	13	31	100%	15.	4	13	31	

3	Cumulative dose of exposure time									
	All MC samples					Positive MC samples				
	Mean	5%	50%	95%	% pos	Mean	5%	50%	95%	
Breathe-Lo	0.01	0	0	0	0.77%	1.3	1	1	3	
Breathe-Hi	0.097	0	0	0	5%	1.9	1	1	6	
Speak-Lo	0.064	0	0	1	6.1%	1.	1	1	1	
Speak-Hi	0.079	0	0	1	7.4%	1.1	1	1	2	
Cough-Lo	0.012	0	0	0	1%	1.2	1	1	3	
Cough-Hi	0.44	0	0	2	32%	1.4	1	1	3	
Sneeze-Lo	0.47	0	0	2	36%	1.3	1	1	3	
Sneeze-Hi	3.5	0	3	9	93%	3.8	1	3	9	



Blootstelling en infectierisico

- Vergadering
- Tien+één personen
- Duurt één uur
- 1: geen ventilatie
- 2: 12 L/s/p=432m³/uur=0,1xruimte/10min.
- 3: 120 L/s/p=432m³/uur=1xruimte/10min.

1	Exposure probability				Infection risk			
	Mean	5%	50%	95%	Mean	5%	50%	95%
Breathe-Lo	1.3%	0%	0%	0%	0.2%	0%	0%	0%
Breathe-Hi	7.2%	0%	0%	45%	1.5%	0%	0%	5.8%
Speak-Lo	8.6%	0%	0%	45%	1.2%	0%	0%	5.8%
Speak-Hi	11%	0%	0%	45%	1.6%	0%	0%	5.8%
Cough-Lo	2.2%	0%	0%	0%	0.31%	0%	0%	0%
Cough-Hi	55%	0%	70%	99%	12%	0%	11%	38%
Sneeze-Lo	64%	0%	70%	97%	14%	0%	11%	30%
Sneeze-Hi	99%	97%	100%	100%	62%	30%	64%	91%

2	Exposure probability				Infection risk			
	Mean	5%	50%	95%	Mean	5%	50%	95%
Breathe-Lo	0.97%	0%	0%	0%	0.15%	0%	0%	0%
Breathe-Hi	6.2%	0%	0%	45%	1.3%	0%	0%	5.8%
Speak-Lo	7.2%	0%	0%	45%	0.97%	0%	0%	5.8%
Speak-Hi	9.8%	0%	0%	45%	1.3%	0%	0%	5.8%
Cough-Lo	1.7%	0%	0%	0%	0.25%	0%	0%	0%
Cough-Hi	48%	0%	45%	97%	9.7%	0%	5.8%	30%
Sneeze-Lo	54%	0%	70%	95%	10%	0%	11%	26%
Sneeze-Hi	98%	91%	100%	100%	54%	21%	54%	84%

3	Exposure probability				Infection risk			
	Mean	5%	50%	95%	Mean	5%	50%	95%
Breathe-Lo	0.4%	0%	0%	0%	0.058%	0%	0%	0%
Breathe-Hi	2.7%	0%	0%	0%	0.49%	0%	0%	0%
Speak-Lo	2.8%	0%	0%	45%	0.37%	0%	0%	5.8%
Speak-Hi	3.4%	0%	0%	45%	0.46%	0%	0%	5.8%
Cough-Lo	0.5%	0%	0%	0%	0.071%	0%	0%	0%
Cough-Hi	17%	0%	0%	70%	2.5%	0%	0%	11%
Sneeze-Lo	19%	0%	0%	70%	2.7%	0%	0%	11%
Sneeze-Hi	74%	0%	83%	100%	18%	0%	16%	42%



Conclusies

- Voor het scenario in een vergaderruimte met 11 personen, waarvan 1 besmettelijk gedurende een uur, virusconcentratie in aerosol = die in mucus = $10^8/\text{ml}$ (5%):
 - Ademen/spreken leidt via aerosoltransmissie tot een infectierisico van ongeveer 1%
 - Een nies of een hoest leidt via aerosoltransmissie tot een zeer hoog infectierisico
- Volgens het model is effect ventilatie van 12 liter/sec/persoon verwaarloosbaar
- Volgens het model is effect ventilatie van 120 liter/sec/persoon 3-4 x reductie infectierisico